

RESIDENTIAL ENERGY CONSERVATION CODE DOCUMENTATION CHECKLIST

Florida Department of Business and Professional Regulation Simulated Performance Alternative (Performance) Method

Applications for compliance with the 2017 Florida Building Code, Energy Conservation via the residential Simulated Performance Method shall include:

- This checklist*
- A Form R405 report that documents that the Proposed Design complies with Section R405.3 of the Florida Energy Code. This form shall include a summary page indicating home address, e-ratio and the pass or fail status along with summary areas and types of components, whether the home was simulated as a worst-case orientation, name and version of the compliance software tool, name of individual completing the compliance report (one page) and an input summary checklist that can be used for field verification (usually four pages/may be greater).*
- Energy Performance Level (EPL) Display Card (one page)*
- HVAC system sizing and selection based on ACCA Manual S or per exceptions provided in Section R403.7*
- Mandatory Requirements (five pages)*

Required prior to CO for the Performance Method:

- Air Barrier and Insulation Inspection Component Criteria checklist (Table R402.4.1.1 - one page)*
- A completed Envelope Leakage Test Report (usually one page)*
- If Form R405 duct leakage type indicates anything other than "default leakage", then a completed Form R405 Duct Leakage Test Report (usually one page)*

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 98

The lower the EnergyPerformance Index, the more efficient the home.

2101 Clementine St, Naples, FL, 34120

1. New construction or existing	New (From Plans)	9. Wall Types	Insulation	Area
2. Single family or multiple family	Single-family	a. Concrete Block - Ext Insul, Exterior	R=4.1	1656.00 ft²
3. Number of units, if multiple family	1	b. Frame - Wood, Adjacent	R=13.0	270.00 ft²
4. Number of Bedrooms	4	c. N/A	R=	ft²
5. Is this a worst case?	No	d. N/A	R=	ft²
6. Conditioned floor area (ft²)	2032	10. Ceiling Types	Insulation	Area
7. Windows**	Description	Area	R=30.0	2032.00 ft²
a. U-Factor:	Dbl, U=0.58	133.33 ft²	R=	ft²
SHGC:	SHGC=0.35		R=	ft²
b. U-Factor:	Dbl, U=0.56	72.00 ft²		
SHGC:	SHGC=0.32			
c. U-Factor:	N/A	ft²		
SHGC:				
d. U-Factor:	N/A	ft²		
SHGC:				
Area Weighted Average Overhang Depth:	4.104 ft.	11. Ducts	R	ft²
Area Weighted Average SHGC:	0.339	a. Sup: Attic, Ret: Entry, AH: AC	6	804
8. Floor Types	Insulation	Area	12. Cooling systems	kBtu/hr Efficiency
a. Slab-On-Grade Edge Insulation	R=0.0	2032.00 ft²	a. Central Unit	39.5 SEER:14.00
b. N/A	R=	ft²		
c. N/A	R=	ft²	13. Heating systems	kBtu/hr Efficiency
			a. Electric Strip Heat	22.9 COP:1.00
			14. Hot water systems	Cap: 40 gallons
			a. Electric	EF: 0.95
			b. Conservation features	
			None	
			15. Credits	Pstat

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: _____



*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida EnergyGauge Rating. Email EnergyGauge tech support at techsupport@energygauge.com or see the EnergyGauge web site at energygauge.com for information and a list of certified Raters. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

**Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.


FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Business and Professional Regulation - Residential Performance Method

<p>Project Name: OB - Trevi - 2101 Clementine St Street: 2101 Clementine St City, State, Zip: Naples , FL , 34120 Owner: Lennar Design Location: FL, NAPLES_MUNICIPAL</p>	<p>Builder Name: Lennar Permit Office: Collier County Permit Number: Jurisdiction: 211000 County:: Collier (Florida Climate Zone 1)</p>
---	--

<table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:30%;">1. New construction or existing</td> <td style="width:40%;">New (From Plans)</td> <td style="width:30%;"></td> </tr> <tr> <td>2. Single family or multiple family</td> <td>Single-family</td> <td></td> </tr> <tr> <td>3. Number of units, if multiple family</td> <td>1</td> <td></td> </tr> <tr> <td>4. Number of Bedrooms</td> <td>4</td> <td></td> </tr> <tr> <td>5. Is this a worst case?</td> <td>No</td> <td></td> </tr> <tr> <td>6. Conditioned floor area above grade (ft²)</td> <td>2032</td> <td></td> </tr> <tr> <td> Conditioned floor area below grade (ft²)</td> <td>0</td> <td></td> </tr> <tr> <td>7. Windows(205.3 sqft.)</td> <td>Description</td> <td>Area</td> </tr> <tr> <td> a. U-Factor:</td> <td>Dbl, U=0.58</td> <td>133.33 ft²</td> </tr> <tr> <td> SHGC:</td> <td>SHGC=0.35</td> <td></td> </tr> <tr> <td> b. U-Factor:</td> <td>Dbl, U=0.56</td> <td>72.00 ft²</td> </tr> <tr> <td> SHGC:</td> <td>SHGC=0.32</td> <td></td> </tr> <tr> <td> c. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td> SHGC:</td> <td></td> <td></td> </tr> <tr> <td> d. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td> SHGC:</td> <td></td> <td></td> </tr> <tr> <td> Area Weighted Average Overhang Depth:</td> <td>4.104 ft.</td> <td></td> </tr> <tr> <td> Area Weighted Average SHGC:</td> <td>0.339</td> <td></td> </tr> <tr> <td>8. Floor Types (2032.0 sqft.)</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td> a. Slab-On-Grade Edge Insulation</td> <td>R=0.0</td> <td>2032.00 ft²</td> </tr> <tr> <td> b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> </table>	1. New construction or existing	New (From Plans)		2. Single family or multiple family	Single-family		3. Number of units, if multiple family	1		4. Number of Bedrooms	4		5. Is this a worst case?	No		6. Conditioned floor area above grade (ft²)	2032		Conditioned floor area below grade (ft²)	0		7. Windows(205.3 sqft.)	Description	Area	a. U-Factor:	Dbl, U=0.58	133.33 ft²	SHGC:	SHGC=0.35		b. U-Factor:	Dbl, U=0.56	72.00 ft²	SHGC:	SHGC=0.32		c. U-Factor:	N/A	ft²	SHGC:			d. U-Factor:	N/A	ft²	SHGC:			Area Weighted Average Overhang Depth:	4.104 ft.		Area Weighted Average SHGC:	0.339		8. Floor Types (2032.0 sqft.)	Insulation	Area	a. Slab-On-Grade Edge Insulation	R=0.0	2032.00 ft²	b. N/A	R=	ft²	c. N/A	R=	ft²	<table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:50%;">9. Wall Types(1926.0 sqft.)</td> <td style="width:25%;">Insulation</td> <td style="width:25%;">Area</td> </tr> <tr> <td> a. Concrete Block - Ext Insul, Exterior</td> <td>R=4.1</td> <td>1656.00 ft²</td> </tr> <tr> <td> b. Frame - Wood, Adjacent</td> <td>R=13.0</td> <td>270.00 ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> d. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>10. Ceiling Types (2032.0 sqft.)</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td> a. Under Attic (Vented)</td> <td>R=30.0</td> <td>2032.00 ft²</td> </tr> <tr> <td> b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>11. Ducts</td> <td></td> <td>R ft²</td> </tr> <tr> <td> a. Sup: Attic, Ret: Entry, AH: AC</td> <td></td> <td>6 804</td> </tr> <tr> <td>12. Cooling systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td> a. Central Unit</td> <td>39.5</td> <td>SEER:14.00</td> </tr> <tr> <td>13. Heating systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td> a. Electric Strip Heat</td> <td>22.9</td> <td>COP:1.00</td> </tr> <tr> <td>14. Hot water systems</td> <td></td> <td>Cap: 40 gallons</td> </tr> <tr> <td> a. Electric</td> <td></td> <td>EF: 0.950</td> </tr> <tr> <td> b. Conservation features</td> <td></td> <td>None</td> </tr> <tr> <td>15. Credits</td> <td></td> <td>Pstat</td> </tr> </table>	9. Wall Types(1926.0 sqft.)	Insulation	Area	a. Concrete Block - Ext Insul, Exterior	R=4.1	1656.00 ft²	b. Frame - Wood, Adjacent	R=13.0	270.00 ft²	c. N/A	R=	ft²	d. N/A	R=	ft²	10. Ceiling Types (2032.0 sqft.)	Insulation	Area	a. Under Attic (Vented)	R=30.0	2032.00 ft²	b. N/A	R=	ft²	c. N/A	R=	ft²	11. Ducts		R ft²	a. Sup: Attic, Ret: Entry, AH: AC		6 804	12. Cooling systems	kBtu/hr	Efficiency	a. Central Unit	39.5	SEER:14.00	13. Heating systems	kBtu/hr	Efficiency	a. Electric Strip Heat	22.9	COP:1.00	14. Hot water systems		Cap: 40 gallons	a. Electric		EF: 0.950	b. Conservation features		None	15. Credits		Pstat
1. New construction or existing	New (From Plans)																																																																																																																											
2. Single family or multiple family	Single-family																																																																																																																											
3. Number of units, if multiple family	1																																																																																																																											
4. Number of Bedrooms	4																																																																																																																											
5. Is this a worst case?	No																																																																																																																											
6. Conditioned floor area above grade (ft²)	2032																																																																																																																											
Conditioned floor area below grade (ft²)	0																																																																																																																											
7. Windows(205.3 sqft.)	Description	Area																																																																																																																										
a. U-Factor:	Dbl, U=0.58	133.33 ft²																																																																																																																										
SHGC:	SHGC=0.35																																																																																																																											
b. U-Factor:	Dbl, U=0.56	72.00 ft²																																																																																																																										
SHGC:	SHGC=0.32																																																																																																																											
c. U-Factor:	N/A	ft²																																																																																																																										
SHGC:																																																																																																																												
d. U-Factor:	N/A	ft²																																																																																																																										
SHGC:																																																																																																																												
Area Weighted Average Overhang Depth:	4.104 ft.																																																																																																																											
Area Weighted Average SHGC:	0.339																																																																																																																											
8. Floor Types (2032.0 sqft.)	Insulation	Area																																																																																																																										
a. Slab-On-Grade Edge Insulation	R=0.0	2032.00 ft²																																																																																																																										
b. N/A	R=	ft²																																																																																																																										
c. N/A	R=	ft²																																																																																																																										
9. Wall Types(1926.0 sqft.)	Insulation	Area																																																																																																																										
a. Concrete Block - Ext Insul, Exterior	R=4.1	1656.00 ft²																																																																																																																										
b. Frame - Wood, Adjacent	R=13.0	270.00 ft²																																																																																																																										
c. N/A	R=	ft²																																																																																																																										
d. N/A	R=	ft²																																																																																																																										
10. Ceiling Types (2032.0 sqft.)	Insulation	Area																																																																																																																										
a. Under Attic (Vented)	R=30.0	2032.00 ft²																																																																																																																										
b. N/A	R=	ft²																																																																																																																										
c. N/A	R=	ft²																																																																																																																										
11. Ducts		R ft²																																																																																																																										
a. Sup: Attic, Ret: Entry, AH: AC		6 804																																																																																																																										
12. Cooling systems	kBtu/hr	Efficiency																																																																																																																										
a. Central Unit	39.5	SEER:14.00																																																																																																																										
13. Heating systems	kBtu/hr	Efficiency																																																																																																																										
a. Electric Strip Heat	22.9	COP:1.00																																																																																																																										
14. Hot water systems		Cap: 40 gallons																																																																																																																										
a. Electric		EF: 0.950																																																																																																																										
b. Conservation features		None																																																																																																																										
15. Credits		Pstat																																																																																																																										

Glass/Floor Area: 0.101	Total Proposed Modified Loads: 70.64	PASS
	Total Baseline Loads: 72.13	

<p>I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.</p> <p>PREPARED BY: _____ DATE: April 6, 2018</p> <p>I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.</p> <p>OWNER/AGENT: K. Assini DATE: 4/9/18</p>	<p>Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.</p> <div style="text-align: center;">  </div> <p>BUILDING OFFICIAL: _____ DATE: _____</p>
--	---

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires an envelope leakage test report with envelope leakage no greater than 7.00 ACH50 (R402.4.1.2).

PROJECT

Title:	OB - Trevi - 2101 Clementine	Bedrooms:	4	Address Type:	Street Address
Building Type:	User	Conditioned Area:	2032	Lot #	
Owner Name:	Lennar	Total Stories:	1	Block/Subdivision:	
# of Units:	1	Worst Case:	No	PlatBook:	
Builder Name:	Lennar	Rotate Angle:	180	Street:	2101 Clementine St
Permit Office:	Collier County	Cross Ventilation:	No	County:	Collier
Jurisdiction:	211000	Whole House Fan:	No	City, State, Zip:	Naples , FL , 34120
Family Type:	Single-family				
New/Existing:	New (From Plans)				
Comment:					

CLIMATE

✓	Design Location	TMY Site	Design Temp		Int Design Temp		Heating Degree Days	Design Moisture	Daily Temp Range
			97.5 %	2.5 %	Winter	Summer			
	FL, NAPLES_MUNICIPAL	FL_NAPLES_MUNICIPAL	46	90	70	75	288.5	58	Medium

BLOCKS

Number	Name	Area	Volume
1	Entire House	2032	20320

SPACES

Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Infil ID	Finished	Cooled	Heated
1	Bedroom 3	168	1680	No	2	1	1	Yes	Yes	Yes
2	Bath 3	54	540	No	0		1	Yes	Yes	Yes
3	Laundry	36	360	No	0		1	Yes	Yes	Yes
4	Bedroom 4	154	1540	No	2	1	1	Yes	Yes	Yes
5	Family Room	528	5280	No	0		1	Yes	Yes	Yes
6	Master Bedroom	264	2640	No	2	1	1	Yes	Yes	Yes
7	Her WIC	48	480	No	0		1	Yes	Yes	Yes
8	His WIC	36	360	No	0		1	Yes	Yes	Yes
9	Master Bath	120	1200	No	0		1	Yes	Yes	Yes
10	Bath 2	50	500	No	0		1	Yes	Yes	Yes
11	Bedroom 2	140	1400	No	2	1	1	Yes	Yes	Yes
12	Kitchen	177	1770	Yes	0		1	Yes	Yes	Yes
13	Pantry	21	210	No	0		1	Yes	Yes	Yes
14	AC	16	160	No	0		1	Yes	Yes	Yes
15	Entry	200	2000	No	0		1	Yes	Yes	Yes
16	Toilet	20	200	No	0		1	Yes	Yes	Yes

FLOORS

✓	#	Floor Type	Space	Perimeter	Perimeter R-Value	Area	Joist R-Value	Tile	Wood	Carpet
	1	Slab-On-Grade Edge Insulatio	Bedroom 3	38 ft	0	168 ft²	----	1	0	0
	2	Slab-On-Grade Edge Insulatio	Bath 3	9 ft	0	54 ft²	----	1	0	0

FLOORS

✓	#	Floor Type	Space	Perimeter	Perimeter R-Value	Area	Joist R-Value	Tile	Wood	Carpet
✓	3	Slab-On-Grade Edge Insulatio	Laundry	1 ft	0	36 ft ²	----	1	0	0
✓	4	Slab-On-Grade Edge Insulatio	Bedroom 4	11 ft	0	154 ft ²	----	1	0	0
✓	5	Slab-On-Grade Edge Insulatio	Family Room	46 ft	0	528 ft ²	----	1	0	0
✓	6	Slab-On-Grade Edge Insulatio	Master Bedroom	31 ft	0	264 ft ²	----	1	0	0
✓	7	Slab-On-Grade Edge Insulatio	Her WIC	14 ft	0	48 ft ²	----	1	0	0
✓	8	Slab-On-Grade Edge Insulatio	His WIC	1 ft	0	36 ft ²	----	1	0	0
✓	9	Slab-On-Grade Edge Insulatio	Master Bath	14 ft	0	120 ft ²	----	1	0	0
✓	10	Slab-On-Grade Edge Insulatio	Bath 2	5 ft	0	50 ft ²	----	1	0	0
✓	11	Slab-On-Grade Edge Insulatio	Bedroom 2	10 ft	0	140 ft ²	----	1	0	0
✓	12	Slab-On-Grade Edge Insulatio	Kitchen	1 ft	0	177 ft ²	----	1	0	0
✓	13	Slab-On-Grade Edge Insulatio	Pantry	1 ft	0	21 ft ²	----	1	0	0
✓	14	Slab-On-Grade Edge Insulatio	AC	1 ft	0	16 ft ²	----	1	0	0
✓	15	Slab-On-Grade Edge Insulatio	Entry	6 ft	0	200 ft ²	----	1	0	0
✓	16	Slab-On-Grade Edge Insulatio	Toilet	1 ft	0	20 ft ²	----	1	0	0

ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
✓	1	Hip	Barrel tile	2201 ft ²	0 ft ²	Medium	0.75	No	0.9	No	0	22.6

ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
✓	1	Full attic	Vented	150	2032 ft ²	N	N

CEILING

✓	#	Ceiling Type	Space	R-Value	Ins Type	Area	Framing Frac	Truss Type
_____	1	Under Attic (Vented)	Bedroom 3	30	Blown	168 ft²	0.1	Wood
_____	2	Under Attic (Vented)	Bath 3	30	Blown	54 ft²	0.1	Wood
_____	3	Under Attic (Vented)	Laundry	30	Blown	36 ft²	0.1	Wood
_____	4	Under Attic (Vented)	Bedroom 4	30	Blown	154 ft²	0.1	Wood
_____	5	Under Attic (Vented)	Family Room	30	Blown	528 ft²	0.1	Wood
_____	6	Under Attic (Vented)	Master Bedroom	30	Blown	264 ft²	0.1	Wood
_____	7	Under Attic (Vented)	Her WIC	30	Blown	48 ft²	0.1	Wood
_____	8	Under Attic (Vented)	His WIC	30	Blown	36 ft²	0.1	Wood
_____	9	Under Attic (Vented)	Master Bath	30	Blown	120 ft²	0.1	Wood
_____	10	Under Attic (Vented)	Bath 2	30	Blown	50 ft²	0.1	Wood
_____	11	Under Attic (Vented)	Bedroom 2	30	Blown	140 ft²	0.1	Wood
_____	12	Under Attic (Vented)	Kitchen	30	Blown	177 ft²	0.1	Wood
_____	13	Under Attic (Vented)	Pantry	30	Blown	21 ft²	0.1	Wood
_____	14	Under Attic (Vented)	AC	30	Blown	16 ft²	0.1	Wood
_____	15	Under Attic (Vented)	Entry	30	Blown	200 ft²	0.1	Wood
_____	16	Under Attic (Vented)	Toilet	30	Blown	20 ft²	0.1	Wood

WALLS

✓	#	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area	Sheathing R-Value	Framing Fraction	Solar Absor	Below Grade%
_____	1	N=>S	Exterior	Concrete Block - Ext Insul	Bedroom 3	4.1	12	0	9	0	108.0 ft²	0	0	0.5	0
_____	2	E=>W	Exterior	Concrete Block - Ext Insul	Bedroom 3	4.1	14	0	9	0	126.0 ft²	0	0	0.5	0
_____	3	S=>N	Exterior	Concrete Block - Ext Insul	Bedroom 3	4.1	12	0	9	0	108.0 ft²	0	0	0.5	0
_____	4	S=>N	Exterior	Concrete Block - Ext Insul	Bath 3	4.1	9	0	9	0	81.0 ft²	0	0	0.5	0
_____	5	E=>W	Garage	Frame - Wood	Laundry	13	6	0	9	0	54.0 ft²	0	0.25	0.01	0
_____	6	S=>N	Exterior	Concrete Block - Ext Insul	Bedroom 4	4.1	11	0	9	0	99.0 ft²	0	0	0.5	0
_____	7	S=>N	Exterior	Concrete Block - Ext Insul	Family Room	4.1	27	0	9	0	243.0 ft²	0	0	0.5	0
_____	8	W=>E	Exterior	Concrete Block - Ext Insul	Family Room	4.1	19	0	9	0	171.0 ft²	0	0	0.5	0
_____	9	N=>S	Exterior	Concrete Block - Ext Insul	Master Bedro	4.1	16	0	9	0	144.0 ft²	0	0	0.5	0
_____	10	W=>E	Exterior	Concrete Block - Ext Insul	Master Bedro	4.1	15	0	9	0	135.0 ft²	0	0	0.5	0
_____	11	S=>N	Exterior	Concrete Block - Ext Insul	Her WIC	4.1	8	0	9	0	72.0 ft²	0	0	0.5	0
_____	12	W=>E	Exterior	Concrete Block - Ext Insul	Her WIC	4.1	6	0	9	0	54.0 ft²	0	0	0.5	0
_____	13	N=>S	Exterior	Concrete Block - Ext Insul	Master Bath	4.1	14	0	9	0	126.0 ft²	0	0	0.5	0
_____	14	N=>S	Exterior	Concrete Block - Ext Insul	Bath 2	4.1	5	0	9	0	45.0 ft²	0	0	0.5	0
_____	15	N=>S	Exterior	Concrete Block - Ext Insul	Bedroom 2	4.1	10	0	9	0	90.0 ft²	0	0	0.5	0
_____	16	E=>W	Garage	Frame - Wood	Bedroom 2	13	14	0	9	0	126.0 ft²	0	0.25	0.01	0
_____	17	E=>W	Exterior	Concrete Block - Ext Insul	Entry	4.1	6	0	9	0	54.0 ft²	0	0	0.5	0
_____	18	N=>S	Garage	Frame - Wood	Entry	13	10	0	9	0	90.0 ft²	0	0.25	0.01	0

DOORS

✓	#	Ornt	Door Type	Space	Storms	U-Value	Width Ft In	Height Ft In	Area
✓	1	E=>W	Insulated	Entry	None	.4	3	8	24 ft²

WINDOWS

Orientation shown is the entered orientation (=>) changed to As Built (rotated 180 degrees).

✓	#	Ornt	Wall ID	Frame	Panes	NFRC	U-Factor	SHGC	Imp	Area	Overhang Depth Separation	Int Shade	Screening
✓	1	E=>W	2	Metal	Low-E Double	Yes	0.58	0.35	Y	24.0 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	2	S=>N	6	Metal	Low-E Double	Yes	0.58	0.35	Y	16.4 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	3	S=>N	7	Metal	Low-E Double	Yes	0.58	0.35	Y	24.0 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	4	W=>E	8	Metal	Low-E Double	Yes	0.56	0.32	Y	72.0 ft²	8 ft 0 in 0 ft 6 in	None	None
✓	5	N=>S	9	Metal	Low-E Double	Yes	0.58	0.35	Y	16.4 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	6	W=>E	10	Metal	Low-E Double	Yes	0.58	0.35	Y	24.0 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	7	N=>S	13	Metal	Low-E Double	Yes	0.58	0.35	Y	12.0 ft²	2 ft 0 in 0 ft 6 in	None	None
✓	8	N=>S	15	Metal	Low-E Double	Yes	0.58	0.35	Y	16.4 ft²	2 ft 0 in 0 ft 6 in	None	None

GARAGE

✓	#	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
✓	1	420 ft²	420 ft²	64 ft	8 ft	1

INFILTRATION

#	Scope	Method	SLA	CFM 50	ELA	EqLA	ACH	ACH 50
1	Wholehouse	Proposed ACH(50)	.000445	2370.7	130.15	244.76	.3336	7

HEATING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Block	Ducts
✓	1	Electric Strip Heat/	None	COP:1	22.9 kBtu/hr	1	sys#1

COOLING SYSTEM

✓	#	System Type	Subtype	Efficiency	Capacity	Air Flow	SHR	Block	Ducts
✓	1	Central Unit/	Split	SEER: 14	39.5 kBtu/hr	cfm	0.7	1	sys#1

HOT WATER SYSTEM

✓	#	System Type	SubType	Location	EF	Cap	Use	SetPnt	Conservation
✓	1	Electric	None	Garage	0.95	40 gal	70 gal	120 deg	None

SOLAR HOT WATER SYSTEM

<input checked="" type="checkbox"/>	FSEC Cert #	Company Name	System Model #	Collector Model #	Collector Area	Storage Volume	FEF
_____	None	None			ft ²		

DUCTS

<input checked="" type="checkbox"/>	#	--- Supply --- Location	R-Value	Area	--- Return --- Location	Area	Leakage Type	Air Handler	CFM 25 TOT	CFM25 OUT	QN	RLF	HVAC # Heat	Cool
_____	1	Attic	6	804 ft ²	Entry	804 ft ²	Default Leakage	AC	(Default)	(Default)			1	1

TEMPERATURES

Programable Thermostat: Y				Ceiling Fans:										
Cooling	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input type="checkbox"/> Nov	<input type="checkbox"/> Dec		
Heating	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec		
Venting	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input type="checkbox"/> Dec		
Thermostat Schedule:	HERS 2006 Reference											Hours		
Schedule Type		1	2	3	4	5	6	7	8	9	10	11	12	
Cooling (WD)	AM	78	78	78	78	78	78	78	78	80	80	80	80	80
	PM	80	80	78	78	78	78	78	78	78	78	78	78	78
Cooling (WEH)	AM	78	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78	78
Heating (WD)	AM	66	66	66	66	66	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	66	66
Heating (WEH)	AM	66	66	66	66	66	68	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	68	66	66

Florida Building Code, Energy Conservation, 6th Edition (2017) Mandatory Requirements for Residential Performance, Prescriptive and ERI Methods

ADDRESS: 2101 Clementine St
Naples, FL, 34120

Permit Number:

MANDATORY REQUIREMENTS See individual code sections for full details.

SECTION R401 GENERAL

R401.3 Energy Performance Level (EPL) display card (Mandatory). The building official shall require that an energy performance level (EPL) display card be completed and certified by the builder to be accurate and correct before final approval of the building for occupancy. Florida law (Section 553.9085, Florida Statutes) requires the EPL display card to be included as an addendum to each sales contract for both presold and nonpresold residential buildings. The EPL display card contains information indicating the energy performance level and efficiencies of components installed in a dwelling unit. The building official shall verify that the EPL display card completed and signed by the builder accurately reflects the plans and specifications submitted to demonstrate code compliance for the building. A copy of the EPL display card can be found in Appendix RD.

R402.4 Air leakage (Mandatory). The building thermal envelope shall be constructed to limit air leakage in accordance with the requirements of Sections R402.4.1 through R402.4.5.

Exception: Dwelling units of R-2 Occupancies and multiple attached single family dwellings shall be permitted to comply with Section C402.5.

R402.4.1 Building thermal envelope. The building thermal envelope shall comply with Sections R402.4.1.1 and R402.4.1.2. The sealing methods between dissimilar materials shall allow for differential expansion and contraction.

R402.4.1.1 Installation. The components of the building thermal envelope as listed in Table R402.4.1.1 shall be installed in accordance with the manufacturer's instructions and the criteria listed in Table R402.4.1.1, as applicable to the method of construction. Where required by the code official, an approved third party shall inspect all components and verify compliance.

R402.4.1.2 Testing. The building or dwelling unit shall be tested and verified as having an air leakage rate not exceeding seven air changes per hour in Climate Zones 1 and 2, and three air changes per hour in Climate Zones 3 through 8. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.

Exception: Testing is not required for additions, alterations, renovations, or repairs, of the building thermal envelope of existing buildings in which the new construction is less than 85 percent of the building thermal envelope.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, backdraft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.

R402.4.2 Fireplaces. New wood-burning fireplaces shall have tight-fitting flue dampers or doors, and outdoor combustion air. Where using tight-fitting doors on factory-built fireplaces listed and labeled in accordance with UL 127, the doors shall be tested and listed for the fireplace. Where using tight-fitting doors on masonry fireplaces, the doors shall be listed and labeled in accordance with UL 907.

R402.4.3 Fenestration air leakage. Windows, skylights and sliding glass doors shall have an air infiltration rate of no more than 0.3 cfm per square foot (1.5 L/s/m²), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m²), when tested according to NFRC 400 or AAMA/WDMA/CSA 101/I.S.2/A440 by an accredited, independent laboratory and listed and labeled by the manufacturer.

Exception: Site-built windows, skylights and doors.

MANDATORY REQUIREMENTS - (Continued)

R402.4.4 Rooms containing fuel-burning appliances. In Climate Zones 3 through 8, where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air opening shall be located outside the building thermal envelope or enclosed in a room, isolated from inside the thermal envelope. Such rooms shall be sealed and insulated in accordance with the envelope requirements of Table R402.1.2, where the walls, floors and ceilings shall meet not less than the basement wall R-value requirement. The door into the room shall be fully gasketed and any water lines and ducts in the room insulated in accordance with Section R403. The combustion air duct shall be insulated where it passes through conditioned space to a minimum of R-8.

Exceptions:

1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside.
2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the Florida Building Code, Residential.

R402.4.5 Recessed lighting. Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and labeled as having an air leakage rate not more than 2.0 cfm (0.944 L/s) when tested in accordance with ASTM E283 at a 1.57 psf (75 Pa) pressure differential. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.

SECTION R403 SYSTEMS

R403.1 Controls.

R403.1.1 Thermostat provision (Mandatory). At least one thermostat shall be provided for each separate heating and cooling system.

R403.1.3 Heat pump supplementary heat (Mandatory). Heat pumps having supplementary electric-resistance heat shall have controls that, except during defrost, prevent supplemental heat operation when the heat pump compressor can meet the heating load.

R403.3.2 Sealing (Mandatory) All ducts, air handlers, filter boxes and building cavities that form the primary air containment passageways for air distribution systems shall be considered ducts or plenum chambers, shall be constructed and sealed in accordance with Section C403.2.9.2 of the Commercial Provisions of this code and shall be shown to meet duct tightness criteria below.

Duct tightness shall be verified by testing in accordance with ANSI/RESNET/ICC 380 by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i), Florida Statutes, to be "substantially leak free" in accordance with Section R403.3.3.

R403.3.2.1 Sealed air handler. Air handlers shall have a manufacturer's designation for an air leakage of no more than 2 percent of the design airflow rate when tested in accordance with ASHRAE 193.

R403.3.3 Duct testing (Mandatory). Ducts shall be pressure tested to determine air leakage by one of the following methods:

1. Rough-in test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the system, including the manufacturer's air handler enclosure if installed at the time of the test. All registers shall be taped or otherwise sealed during the test.
2. Postconstruction test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the entire system, including the manufacturer's air handler enclosure. Registers shall be taped or otherwise sealed during the test.

Exceptions:

1. A duct air leakage test shall not be required where the ducts and air handlers are located entirely within the building thermal envelope.
2. Duct testing is not mandatory for buildings complying by Section 405 of this code.

A written report of the results of the test shall be signed by the party conducting the test and provided to the code official.

R403.3.5 Building cavities (Mandatory). Building framing cavities shall not be used as ducts or plenums.

R403.4 Mechanical system piping insulation (Mandatory). Mechanical system piping capable of carrying fluids above 105°F (41°C) or below 55°F (13°C) shall be insulated to a minimum of R-3.

R403.4.1 Protection of piping insulation. Piping insulation exposed to weather shall be protected from damage, including that caused by sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesive tape shall not be permitted.

R403.5.1 Heated water circulation and temperature maintenance systems (Mandatory) Heated water circulation systems shall be in accordance with Section R403.5.1.1. Heat trace temperature maintenance systems shall be in accordance with Section R403.5.1.2. Automatic controls, temperature sensors and pumps shall be accessible. Manual controls shall be readily accessible.

R403.5.1.1 Circulation systems. Heated water circulation systems shall be provided with a circulation pump. The system return pipe shall be a dedicated return pipe or a cold water supply pipe. Gravity and thermosiphon circulation systems shall be prohibited. Controls for circulating hot water system pumps shall start the pump based on the identification of a demand for hot water within the occupancy. The controls shall automatically turn off the pump when the water in the circulation loop is at the desired temperature and when there is no demand for hot water.

R403.5.1.2 Heat trace systems. Electric heat trace systems shall comply with IEEE 515.1 or UL 515. Controls for such systems shall automatically adjust the energy input to the heat tracing to maintain the desired water temperature in the piping in accordance with the times when heated water is used in the occupancy.

MANDATORY REQUIREMENTS - (Continued)

R403.5.5 Heat traps (Mandatory). Storage water heaters not equipped with integral heat traps and having vertical pipe risers shall have heat traps installed on both the inlets and outlets. External heat traps shall consist of either a commercially available heat trap or a downward and upward bend of at least 3 ½ inches (89 mm) in the hot water distribution line and cold water line located as close as possible to the storage tank.

R403.5.6 Water heater efficiencies (Mandatory).

R403.5.6.1.1 Automatic controls. Service water-heating systems shall be equipped with automatic temperature controls capable of adjustment from the lowest to the highest acceptable temperature settings for the intended use. The minimum temperature setting range shall be from 100°F to 140°F (38°C to 60°C).

R403.5.6.1.2 Shut down. A separate switch or a clearly marked circuit breaker shall be provided to permit the power supplied to electric service systems to be turned off. A separate valve shall be provided to permit the energy supplied to the main burner(s) of combustion types of service water-heating systems to be turned off.

R403.5.6.2 Water-heating equipment. Water-heating equipment installed in residential units shall meet the minimum efficiencies of Table C404.2 in Chapter 4 of the Florida Building Code, Energy Conservation, Commercial Provisions, for the type of equipment installed. Equipment used to provide heating functions as part of a combination system shall satisfy all stated requirements for the appropriate water-heating category. Solar water heaters shall meet the criteria of Section R403.5.6.2.1.

R403.5.6.2.1 Solar water-heating systems. Solar systems for domestic hot water production are rated by the annual solar energy factor of the system. The solar energy factor of a system shall be determined from the Florida Solar Energy Center Directory of Certified Solar Systems. Solar collectors shall be tested in accordance with ISO Standard 9806, Test Methods for Solar Collectors, and SRCC Standard TM-1, Solar Domestic Hot Water System and Component Test Protocol. Collectors in installed solar water-heating systems should meet the following criteria:

1. Be installed with a tilt angle between 10 degrees and 40 degrees of the horizontal; and
2. Be installed at an orientation within 45 degrees of true south.

R403.6 Mechanical ventilation (Mandatory). The building shall be provided with ventilation that meets the requirements of the Florida Building Code, Residential, or Florida Building Code, Mechanical, as applicable, or with other approved means of ventilation including: Natural, Infiltration or Mechanical means. Outdoor air intakes and exhausts shall have automatic or gravity dampers that close when the ventilation system is not operating.

R403.6.1 Whole-house mechanical ventilation system fan efficacy. When installed to function as a whole-house mechanical ventilation system, fans shall meet the efficacy requirements of Table R403.6.1.

Exception: Where whole-house mechanical ventilation fans are integral to tested and listed HVAC equipment, they shall be powered by an electronically commutated motor.

R403.6.2 Ventilation air. When installed to function as a whole-house mechanical ventilation system, fans shall meet the efficacy requirements of Table R403.6.1.

1. The design air change per hour minimums for residential buildings in ASHRAE 62.2, Ventilation for Acceptable Indoor Air Quality, shall be the maximum rates allowed for residential applications.
2. No ventilation or air-conditioning system make-up air shall be provided to conditioned space from attics, crawlspaces, attached enclosed garages or outdoor spaces adjacent to swimming pools or spas.
3. If ventilation air is drawn from enclosed space(s), then the walls of the space(s) from which air is drawn shall be insulated to a minimum of R-11 and the ceiling shall be insulated to a minimum of R-19, space permitting, or R-10 otherwise.

R403.7 Heating and cooling equipment (Mandatory).

R403.7.1 Equipment sizing. Heating and cooling equipment shall be sized in accordance with ACCA Manual S based on the equipment loads calculated in accordance with ACCA Manual J or other approved heating and cooling calculation methodologies, based on building loads for the directional orientation of the building. The manufacturer and model number of the outdoor and indoor units (if split system) shall be submitted along with the sensible and total cooling capacities at the design conditions described in Section R302.1. This Code does not allow designer safety factors, provisions for future expansion or other factors that affect equipment sizing. System sizing calculations shall not include loads created by local intermittent mechanical ventilation such as standard kitchen and bathroom exhaust systems. New or replacement heating and cooling equipment shall have an efficiency rating equal to or greater than the minimum required by federal law for the geographic location where the equipment is installed.

**TABLE R403.6.1
WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM FAN EFFICACY**

FAN LOCATION	AIRFLOW RATE MINIMUM (CFM)	MINIMUM EFFICACY ^a (CFM/WATT)	AIRFLOW RATE MAXIMUM (CFM)
Range hoods	Any	2.8 cfm/watt	Any
In-line fan	Any	2.8 cfm/watt	Any
Bathroom, utility room	10	1.4 cfm/watt	<90
Bathroom, utility room	90	2.8 cfm/watt	Any

For SI: 1 cfm = 28.3 L/min.

a. When tested in accordance with HVI Standard 916

MANDATORY REQUIREMENTS - (Continued)

R403.7.1.1 Cooling equipment capacity. Cooling only equipment shall be selected so that its total capacity is not less than the calculated total load but not more than 1.15 times greater than the total load calculated according to the procedure selected in Section 403.7, or the closest available size provided by the manufacturer's product lines. The corresponding latent capacity of the equipment shall not be less than the calculated latent load.

The published value for AHRI total capacity is a nominal, rating-test value and shall not be used for equipment sizing. Manufacturer's expanded performance data shall be used to select cooling-only equipment. This selection shall be based on the outdoor design dry-bulb temperature for the load calculation (or entering water temperature for water-source equipment), the blower CFM provided by the expanded performance data, the design value for entering wet-bulb temperature and the design value for entering dry-bulb temperature.

Design values for entering wet-bulb and dry-bulb temperatures shall be for the indoor dry bulb and relative humidity used for the load calculation and shall be adjusted for return side gains if the return duct(s) is installed in an unconditioned space.

Exceptions:

1. Attached single- and multiple-family residential equipment sizing may be selected so that its cooling capacity is less than the calculated total sensible load but not less than 80 percent of that load.
2. When signed and sealed by a Florida-registered engineer, in attached single- and multiple-family units, the capacity of equipment may be sized in accordance with good design practice.

R403.7.1.2 Heating equipment capacity.

R403.7.1.2.1 Heat pumps. Heat pump sizing shall be based on the cooling requirements as calculated according to Section R403.7.1.1, and the heat pump total cooling capacity shall not be more than 1.15 times greater than the design cooling load even if the design heating load is 1.15 times greater than the design cooling load.

R403.7.1.2.2 Electric resistance furnaces. Electric resistance furnaces shall be sized within 4 kW of the design requirements calculated according to the procedure selected in Section R403.7.1.

R403.7.1.2.3 Fossil fuel heating equipment. The capacity of fossil fuel heating equipment with natural draft atmospheric burners shall not be less than the design load calculated in accordance with Section R403.7.1.

R403.7.1.3 Extra capacity required for special occasions. Residences requiring excess cooling or heating equipment capacity on an intermittent basis, such as anticipated additional loads caused by major entertainment events, shall have equipment sized or controlled to prevent continuous space cooling or heating within that space by one or more of the following options:

1. A separate cooling or heating system is utilized to provide cooling or heating to the major entertainment areas.
2. A variable capacity system sized for optimum performance during base load periods is utilized.

R403.8 Systems serving multiple dwelling units (Mandatory). Systems serving multiple dwelling units shall comply with Sections C403 and C404 of the IECC—Commercial Provisions in lieu of Section R403.

R403.9 Snow melt and ice system controls (Mandatory) Snow- and ice-melting systems, supplied through energy service to the building, shall include automatic controls capable of shutting off the system when the pavement temperature is above 50°F (10°C), and no precipitation is falling and an automatic or manual control that will allow shutoff when the outdoor temperature is above 40°F (4.8°C).

R403.10 Pools and permanent spa energy consumption (Mandatory). The energy consumption of pools and permanent spas shall be in accordance with Sections R403.10.1 through R403.10.5.

R403.10.1 Heaters. The electric power to heaters shall be controlled by a readily accessible on-off switch that is an integral part of the heater mounted on the exterior of the heater, or external to and within 3 feet (914 mm) of the heater. Operation of such switch shall not change the setting of the heater thermostat. Such switches shall be in addition to a circuit breaker for the power to the heater. Gas-fired heaters shall not be equipped with continuously burning ignition pilots.

R403.10.2 Time switches. Time switches or other control methods that can automatically turn off and on according to a preset schedule shall be installed for heaters and pump motors. Heaters and pump motors that have built-in time switches shall be in compliance with this section.

Exceptions:

1. Where public health standards require 24-hour pump operation.
2. Pumps that operate solar- and waste-heat-recovery pool heating systems.
3. Where pumps are powered exclusively from on-site renewable generation.

R403.10.3 Covers. Outdoor heated swimming pools and outdoor permanent spas shall be equipped with a vapor-retardant cover on or at the water surface or a liquid cover or other means proven to reduce heat loss.

Exception: Where more than 70 percent of the energy for heating, computed over an operation season, is from site-recovered energy, such as from a heat pump or solar energy source, covers or other vapor-retardant means shall not be required.

R403.10.4 Gas- and oil-fired pool and spa heaters. All gas- and oil-fired pool and spa heaters shall have a minimum thermal efficiency of 82 percent for heaters manufactured on or after April 16, 2013, when tested in accordance with ANSI Z 21.56. Pool heaters fired by natural or LP gas shall not have continuously burning pilot lights.

R403.10.5 Heat pump pool heaters. Heat pump pool heaters shall have a minimum COP of 4.0 when tested in accordance with AHRI 1160, Table 2, Standard Rating Conditions-Low Air Temperature. A test report from an independent laboratory is required to verify procedure compliance. Geothermal swimming pool heat pumps are not required to meet this standard.

R403.11 Portable spas (Mandatory) The energy consumption of electric-powered portable spas shall be controlled by the requirements of APSP-14.

SECTION R404

ELECTRICAL POWER AND LIGHTING SYSTEMS

R404.1 Lighting equipment (Mandatory). Not less than 75 percent of the lamps in permanently installed lighting fixtures shall be high-efficacy lamps or not less than 75 percent of the permanently installed lighting fixtures shall contain only high-efficacy lamps.

Exception: Low-voltage lighting.

R404.1.1 Lighting equipment (Mandatory) Fuel gas lighting systems shall not have continuously burning pilot lights.

2017 - AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA



**TABLE 402.4.1.1
AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA**

Project Name:	OB - Trevi - 2101 Clementine St	Builder Name:	Lennar
Street:	2101 Clementine St	Permit Office:	Collier County
City, State, Zip:	Naples, FL, 34120	Permit Number:	
Owner:	Lennar	Jurisdiction:	211000
Design Location:	FL, NAPLES_MUNICIPAL		

COMPONENT	AIR BARRIER CRITERIA	INSULATION INSTALLATION CRITERIA
General requirements	A continuous air barrier shall be installed in the building envelope. The exterior thermal envelope contains a continuous air barrier. Breaks or joints in the air barrier shall be sealed.	Air-permeable insulation shall not be used as a sealing material.
Ceiling/attic	The air barrier in any dropped ceiling/soffit shall be aligned with the insulation and any gaps in the air barrier shall be sealed. Access openings, drop down stairs or knee wall doors to unconditioned attic spaces shall be sealed.	The insulation in any dropped ceiling/soffit shall be aligned with the air barrier.
Walls	The junction of the foundation and sill plate shall be sealed. The junction of the top plate and the top of exterior walls shall be sealed. Knee walls shall be sealed.	Cavities within corners and headers of frame walls shall be insulated by completely filling the cavity with a material having a thermal resistance of R-3 per inch minimum. Exterior thermal envelope insulation for framed walls shall be installed in substantial contact and continuous alignment with the air barrier.
Windows, skylights and doors	The space between window/door jambs and framing, and skylights and framing shall be sealed.	
Rim joists	Rim joists shall include the air barrier.	Rim joists shall be insulated.
Floors (including above-garage and cantilevered floors)	The air barrier shall be installed at any exposed edge of insulation.	Floor framing cavity insulation shall be installed to maintain permanent contact with the underside of subfloor decking, or floor framing cavity insulation shall be permitted to be in contact with the top side of sheathing, or continuous insulation installed on the underside of floor framing and extends from the bottom to the top of all perimeter floor framing members.
Crawl space walls	Exposed earth in unvented crawl spaces shall be covered with a Class I vapor retarder with overlapping joints taped.	Where provided instead of floor insulation, insulation shall be permanently attached to the crawlspace walls.
Shafts, penetrations	Duct shafts, utility penetrations, and flue shafts opening to exterior or unconditioned space shall be sealed.	
Narrow cavities		Batts in narrow cavities shall be cut to fit, or narrow cavities shall be filled by insulation that on installation readily conforms to the available cavity spaces.
Garage separation	Air sealing shall be provided between the garage and conditioned spaces.	
Recessed lighting	Recessed light fixtures installed in the building thermal envelope shall be sealed to the drywall.	Recessed light fixtures installed in the building thermal envelope shall be air tight and IC rated.
Plumbing and wiring		Batt insulation shall be cut neatly to fit around wiring and plumbing in exterior walls, or insulation that on installation readily conforms to available space shall extend behind piping and wiring.
Shower/tub on exterior wall	The air barrier installed at exterior walls adjacent to showers and tubs shall separate them from the showers and tubs.	Exterior walls adjacent to showers and tubs shall be insulated.
Electrical/phone box or exterior walls	The air barrier shall be installed behind electrical or communication boxes or air-sealed boxes shall be installed.	
HVAC register boots	HVAC register boots that penetrate building thermal envelope shall be sealed to the sub-floor or drywall.	
Concealed sprinklers	When required to be sealed, concealed fire sprinklers shall only be sealed in a manner that is recommended by the manufacturer. Caulking or other adhesive sealants shall not be used to fill voids between fire sprinkler cover plates and walls or ceilings.	

a. In addition, inspection of log walls shall be in accordance with the provisions of ICC-400.

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Envelope Leakage Test Report Performance Method

Project Name: OB - Trevi - 2101 Clementine St	Builder Name: Lennar
Street: 2101 Clementine St	Permit Office: Collier County
City, State, Zip: Naples, FL, 34120	Permit Number:
Design Location: FL, NAPLES_MUNICIPAL	Jurisdiction: 211000
Cond. Floor Area: 2032 sq.ft.	Cond. Volume: 20320 cu ft.

Envelope Leakage Test Results

Regression Data:

C: _____ n: _____ R: _____

Single or Multi Point Test Data

	HOUSE PRESSURE	FLOW:
1	Pa	cfm
2	Pa	cfm
3	Pa	cfm
4	Pa	cfm
5	Pa	cfm
6	Pa	cfm

Leakage Characteristics

Required ACH(50) from
FORM R405-2017 : _____

Tested ACH(50) * : _____

*Tested leakage must be less than or equal to the required ACH(50) shown on Form R405-2017 for this building. If the tested ACH(50) is less than 3 the building must have a mechanical ventilation system.

R402.4.1.2 Testing. The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour in Climate Zones 1 and 2 ... Testing shall be conducted with a blower door at a pressure of 0.2 inches w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), Florida Statutes or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures;
2. Dampers including exhaust, intake, makeup air, backdraft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures;
3. Interior doors, if installed at the time of the test, shall be open;
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed;
5. Heating and cooling systems, if installed at the time of the test, shall be turned off; and
6. Supply and return registers, if installed at the time of the test, shall be fully open.

I hereby certify that the above envelope leakage performance results demonstrate compliance with Florida Energy Code requirements in accordance with Section R402.4.1.2.

SIGNATURE: _____

PRINTED NAME: _____

DATE: _____

Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), Florida Statutes or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the third party conducting the test and provided to the code official.



BUILDING OFFICIAL: _____

DATE: _____



Manual S Compliance Report

Entire House

E-Calcs Plus, Inc.

Job: OB - Trevi - 2101
Date: 4.6.2018
By: E-Calcs Plus, Inc.



9250 Corkscrew Rd, Suite 8, Estero, FL 33928 Phone: 239.810.6106 Email: eric@ecalcsplus.com Web: www.ecalcsplus.com License: HERS Rater ID# 0757810

Project Information

For: OB - Trevi - 2101 Clementine St, Lennar
2101 Clementine St, Naples, FL 34120

Cooling Equipment

Design Conditions

Outdoor design DB:	90.2°F	Sensible gain:	28364 Btuh	Entering coil DB:	76.7°F
Outdoor design WB:	77.4°F	Latent gain:	5955 Btuh	Entering coil WB:	63.6°F
Indoor design DB:	75.0°F	Total gain:	34319 Btuh		
Indoor RH:	50%	Estimated airflow:	1383 cfm		

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Split AC				
Manufacturer:	Lennox	Model:	14ACXS042-230A**+CBX25UH-042-230-*		
Actual airflow:	1383 cfm				
Sensible capacity:	30829 Btuh		109% of load		
Latent capacity:	6372 Btuh		107% of load		
Total capacity:	37201 Btuh		108% of load	SHR:	83%

Heating Equipment

Design Conditions

Outdoor design DB:	47.4°F	Heat loss:	23736 Btuh	Entering coil DB:	69.4°F
Indoor design DB:	70.0°F				

Manufacturer's Performance Data at Actual Design Conditions

Equipment type:	Elec strip				
Manufacturer:	Lennox	Model:	AFUE 100		
Actual airflow:	1383 cfm				
Output capacity:	7.5 kW		108% of load	Temp. rise:	18 °F

Meets all requirements of ACCA Manual S.





Project Summary
Entire House
E-Calcs Plus, Inc.

Job: OB - Trevi - 2101 Clementine St
Date: 4.6.2018
By: E-Calcs Plus, Inc.



9250 Corkscrew Rd, Suite 8, Estero, FL 33928 Phone: 239.810.6106 Email: eric@ecalcsplus.com Web: www.ecalcsplus.com License: HERS Rater ID# 0757810

Project Information

For: OB - Trevi - 2101 Clementine St, Lennar
 2101 Clementine St, Naples, FL 34120

Notes: Front Door Faces East

Design Information

Weather: Naples Municipal, FL, US

Winter Design Conditions

Outside db 47 °F
 Inside db 70 °F
 Design TD 23 °F

Summer Design Conditions

Outside db 90 °F
 Inside db 75 °F
 Design TD 15 °F
 Daily range L
 Relative humidity 50 %
 Moisture difference 57 gr/lb

Heating Summary

Structure 17214 Btuh
 Ducts 6522 Btuh
 Central vent (0 cfm) 0 Btuh
 (none)
 Humidification 0 Btuh
 Piping 0 Btuh
 Equipment load 23736 Btuh

Sensible Cooling Equipment Load Sizing

Structure 20377 Btuh
 Ducts 7987 Btuh
 Central vent (0 cfm) 0 Btuh
 (none)
 Blower 0 Btuh
 Use manufacturer's data y
 Rate/swing multiplier 1.00
 Equipment sensible load 28364 Btuh

Infiltration

Method Simplified
 Construction quality Semi-tight
 Fireplaces 0

Latent Cooling Equipment Load Sizing

Structure 3036 Btuh
 Ducts 2918 Btuh
 Central vent (0 cfm) 0 Btuh
 (none)
 Equipment latent load 5955 Btuh

	Heating	Cooling
Area (ft ²)	2016	2016
Volume (ft ³)	20160	20160
Air changes/hour	0.22	0.11
Equip. AVF (cfm)	74	37

Equipment Total Load (Sen+Lat) 34319 Btuh
 Req. total capacity at 0.70 SHR 3.4 ton

Heating Equipment Summary

Make Lennox
 Trade
 Model AFUE 100
 AHRI ref

Efficiency 100 EFF
 Heating input 7.5 kW
 Heating output 25591 Btuh
 Temperature rise 17 °F
 Actual air flow 1383 cfm
 Air flow factor 0.058 cfm/Btuh
 Static pressure 0.50 in H2O
 Space thermostat

Cooling Equipment Summary

Make Lennox
 Trade LENNOX
 Cond 14ACXS042-230A**
 Coil CBX25UH-042-230-*
 AHRI ref 7627464

Efficiency 12.2 EER, 14 SEER
 Sensible cooling 29050 Btuh
 Latent cooling 12450 Btuh
 Total cooling 41500 Btuh
 Actual air flow 1383 cfm
 Air flow factor 0.049 cfm/Btuh
 Static pressure 0.50 in H2O
 Load sensible heat ratio 0.83

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.






Load Short Form

Entire House

E-Calcs Plus, Inc.

Job: **OB - Trevi - 2101 Clementine St**
 Date: **4.6.2018**
 By: **E-Calcs Plus, Inc.**



9250 Corkscrew Rd, Suite 8, Estero, FL 33928 Phone: 239.810.6106 Email: eric@ecalcsplus.com Web: www.ecalcsplus.com License: HERS Rater ID# 0757810

Project Information

For: **OB - Trevi - 2101 Clementine St, Lennar**
2101 Clementine St, Naples, FL 34120

Design Information

	Htg	Clg	Method	Infiltration
Outside db (°F)	47	90		Simplified
Inside db (°F)	70	75	Construction quality	Semi-tight
Design TD (°F)	23	15	Fireplaces	
Daily range	-	L		
Inside humidity (%)	50	50		
Moisture difference (gr/lb)	16	57		

HEATING EQUIPMENT

Make	Lennox
Trade	
Model	AFUE 100
AHRI ref	
Efficiency	100 EFF
Heating input	7.5 kW
Heating output	25591 Btuh
Temperature rise	17 °F
Actual air flow	1383 cfm
Air flow factor	0.058 cfm/Btuh
Static pressure	0.50 in H2O
Space thermostat	

COOLING EQUIPMENT

Make	Lennox
Trade	LENNOX
Cond	14ACXS042-230A**
Coil	CBX25UH-042-230-*
AHRI ref	7627464
Efficiency	12.2 EER, 14 SEER
Sensible cooling	29050 Btuh
Latent cooling	12450 Btuh
Total cooling	41500 Btuh
Actual air flow	1383 cfm
Air flow factor	0.049 cfm/Btuh
Static pressure	0.50 in H2O
Load sensible heat ratio	0.83

ROOM NAME	Area (ft²)	Htg load (Btuh)	Clg load (Btuh)	Htg AVF (cfm)	Clg AVF (cfm)
Bedroom 3	168	4106	3499	239	171
Bath 3	54	910	428	53	21
Laundry	36	502	1243	29	61
Bedroom 4	154	1426	1554	83	76
Family Room	513	6146	10114	358	493
Master Bedroom	264	3759	4870	219	237
Her WIC	48	1379	622	80	30
His WIC	36	36	44	2	2
Master Bath	120	1613	927	94	45
Bath 2	50	525	262	31	13
Bedroom 2	140	1710	1746	100	85
Kitchen	177	176	1834	10	89
Pantry	21	20	25	1	1
AC	16	0	0	0	0

Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.



Entry Toilet		200 20	1407 20	1173 24	82 1	57 1
Entire House	d	2016	23736	28364	1383	1383
Other equip loads			0	0		
Equip. @ 1.00 RSM				28364		
Latent cooling				5955		
TOTALS		2016	23736	34319	1383	1383



Calculations approved by ACCA to meet all requirements of Manual J 8th Ed.





Building Analysis

Entire House

E-Calcs Plus, Inc.

Job: OB - Trevi - 2101 Clementine St
 Date: 4.6.2018
 By: E-Calcs Plus, Inc.



9250 Corkscrew Rd, Suite 8, Estero, FL 33928 Phone: 239.810.6106 Email: eric@ecalcsplus.com Web: www.ecalcsplus.com License: HERS Rater ID# 0757810

Project Information


For: OB - Trevi - 2101 Clementine St, Lennar
 2101 Clementine St, Naples, FL 34120

Design Conditions

Location:				Indoor:		Heating	Cooling
Naples Municipal, FL, US				Indoor temperature (°F)		70	75
Elevation: 23 ft				Design TD (°F)		23	15
Latitude: 26°N				Relative humidity (%)		50	50
				Moisture difference (gr/lb)		16.0	57.2
Outdoor:		Heating	Cooling	Infiltration:			
Drybulb (°F)		47	90	Method		Simplified	
Daily range (°F)		-	14 (L)	Construction quality		Semi-tight	
Wet bulb (°F)		-	77	Fireplaces		0	
Wind speed (mph)		15.0	7.5				


Heating

Component	Btuh/ft²	Btuh	% of load
Walls	3.1	5787	24.4
Glazing	12.9	2648	11.2
Doors	13.6	579	2.4
Ceilings	0.7	1458	6.1
Floors	2.4	4907	20.7
Infiltration	1.0	1836	7.7
Ducts		6522	27.5
Piping		0	0
Humidification		0	0
Ventilation		0	0
Adjustments		0	0
Total		23736	100.0

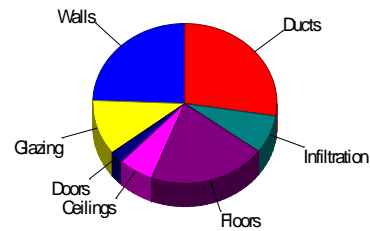

Cooling

Component	Btuh/ft²	Btuh	% of load
Walls	2.5	4642	16.4
Glazing	29.8	6098	21.5
Doors	17.8	760	2.7
Ceilings	0.9	1819	6.4
Floors	0	0	0
Infiltration	0.3	617	2.2
Ducts		7987	28.2
Ventilation		0	0
Internal gains		6440	22.7
Blower		0	0
Adjustments		0	0
Total		28364	100.0

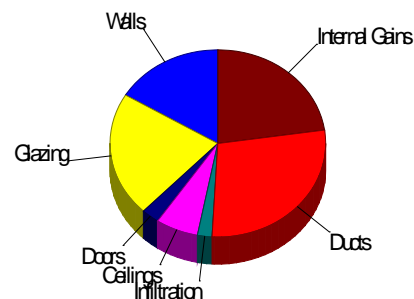


Latent Cooling Load = 5955 Btuh
 Overall U-value = 0.110 Btuh/ft²-°F

Data entries checked.



First Floor

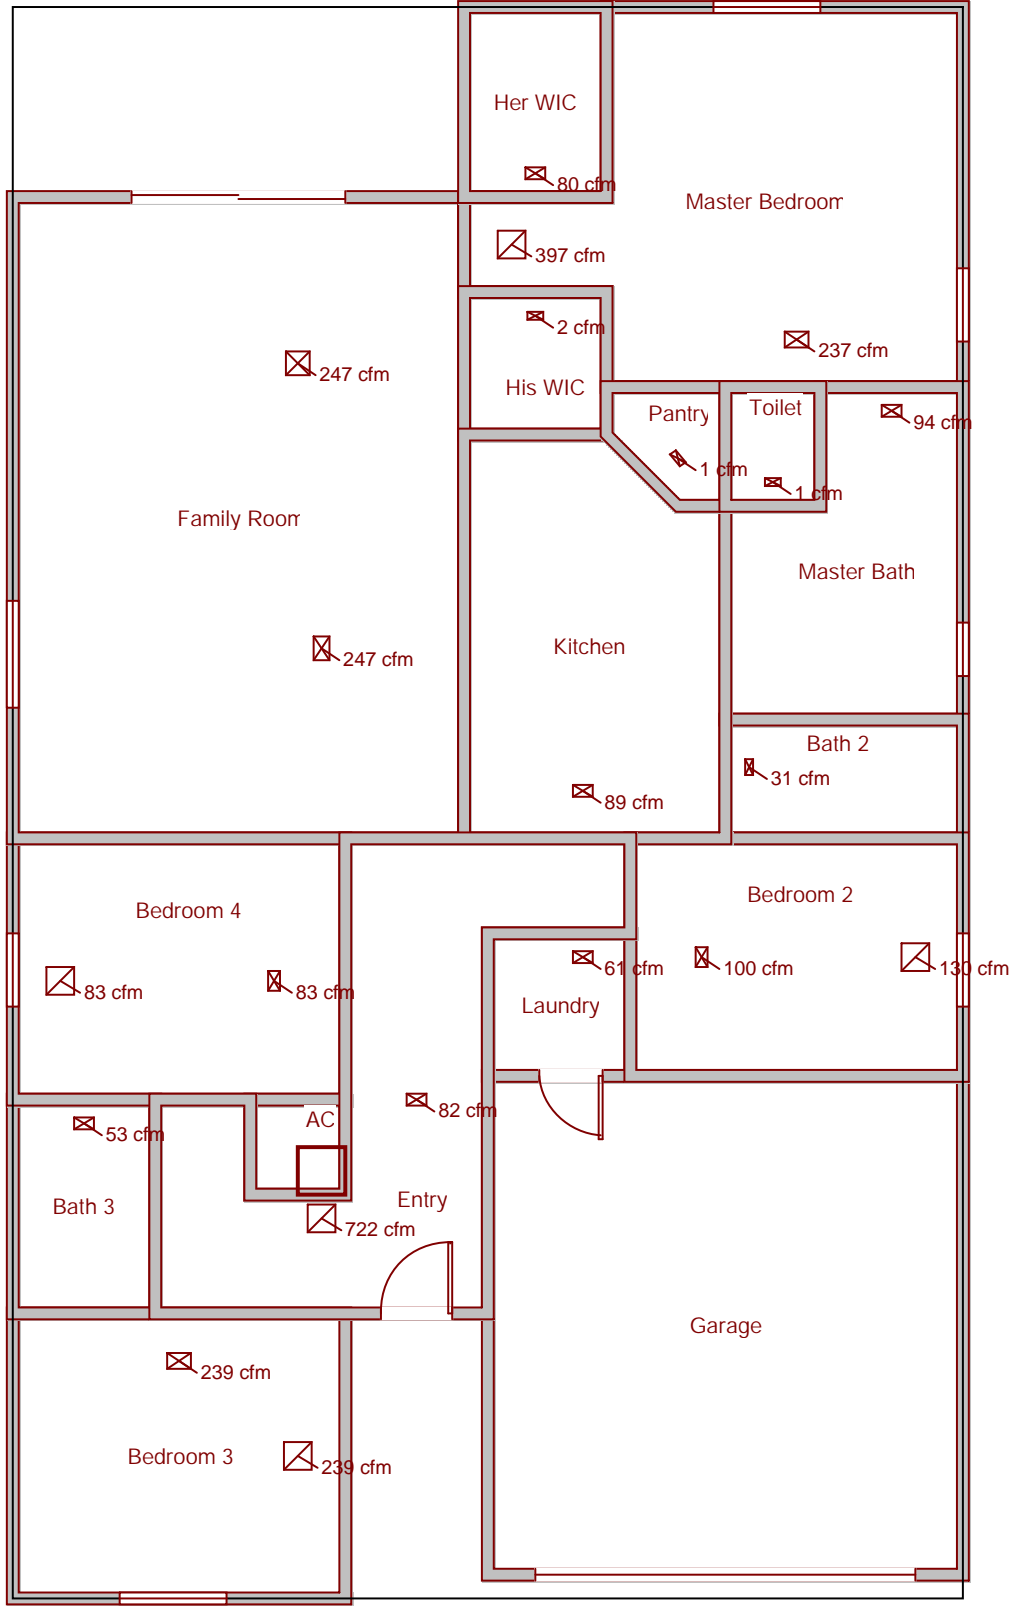

Job #: OB - Trevi - 2101 Clementine St
Performed by E-Calcs Plus, Inc. for:

OB - Trevi - 2101 Clementine St
2101 Clementine St
Naples, FL 34120

E-Calcs Plus, Inc.

9250 Corkscrew Rd, Suite 8
Estero, FL 33928
Phone: 239.810.6106
www.ecalcsplus.com eric@ecalcsplus.com

Scale: 1 : 97

Page 1
Right-Suite@ Universal 2018
18.0.08 RSU25198
2018-Apr-06 06:53:18
... 2101 Clementine St 4.6.2018.rup