



NORTH COLLIER FIRE CONTROL AND RESCUE DISTRICT Prevention Bureau

BOARD OF FIRE COMMISSION

J. Christopher Lombardo, Chairman ■ Norman E. Feder, Vice Chairman ■ Richard Hoffman, Secretary-Treasurer
James Burke, Commissioner ■ Ramon E. Chao, Commissioner ■ Christopher L. Crossan, Commissioner
Margaret Hanson, Commissioner ■ John O. McGowan, Commissioner

January 25, 2016

Ms. Candace Woodworth
Waldrop Engineering
28100 Bonita Grande Drive #205
Bonita Springs, FL 34135

Fax: 239-405-7899

Re: Flow Test @ DiLillo Project – Off of Esplanade Blvd.

(Flow #67-036 – Static Residual #67-038)

The North Collier Fire Control and Rescue District has conducted a flow test at the above location. This also will serve as an invoice in the amount of \$100.00 to cover the cost of the test. (Paid #1131).

Please make your check payable to North Collier Fire District and please reference the name of the project on your check.


Following are the results of the flow test:

Static:	88	Residual:	73
Total Flow GPM:	2,122	Pitot:	40 x 2 Ports
Flow @ 20 PSI GPM:	4,801	Time:	12:00 PM – 1-21-16

If you have any questions, please do not hesitate to contact me @ (239) 597-9227.

Sincerely,

Eloy Ricardo
Deputy Chief of Life Safety & Fire Prevention
North Collier Fire District

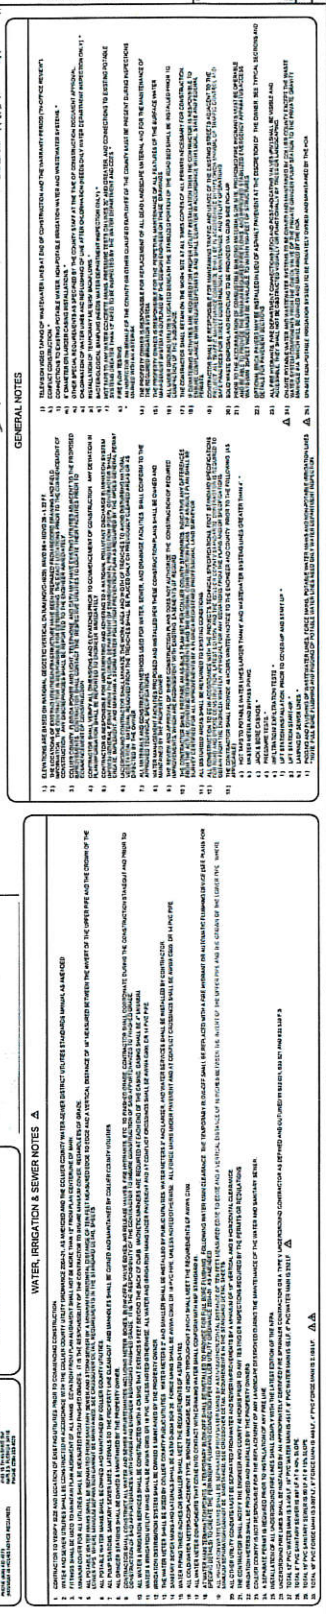

T-1110 Parcel located here